HRS dipoles: CURRENT CONTROL

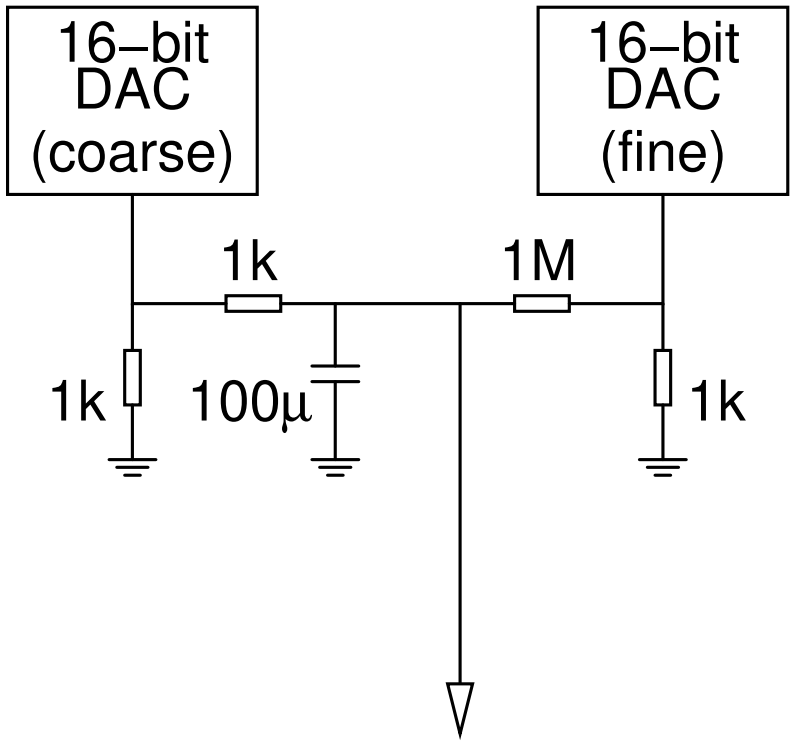

I directly proportional to V

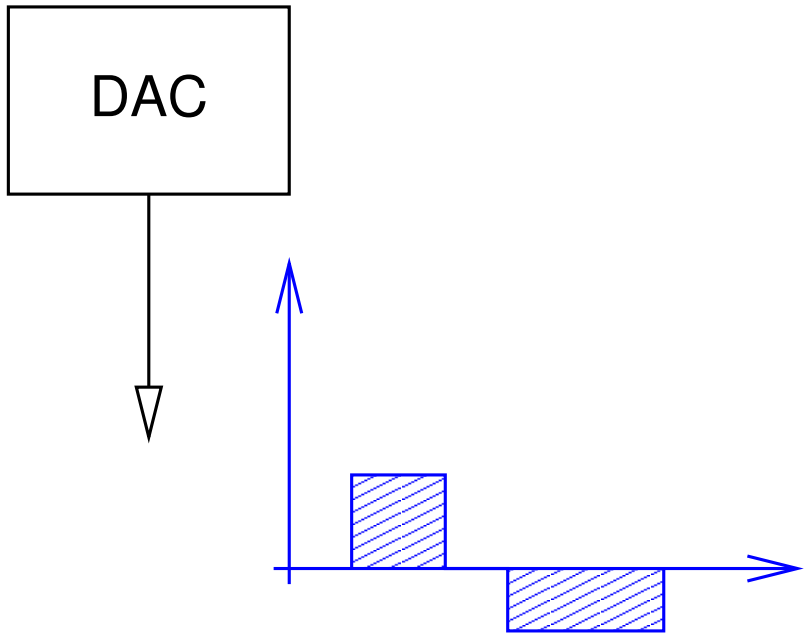

delta–I proportional to V.t

no readback of power supply current!